


# HANDLE WITH MICROSWITCH CONNECTION SCHEMES




WALA sp. z o. o.  
43-365 Wilkowice  
TEL. 338272390

Technical parameters:	
Supply voltage:	12-24V DC (DO NOT USE AC/alternate current)
Relay:	12V-24V 1A (max)*
Temperature range:	-20 do + 50 degrees

\* Input voltage (supply voltage) = output voltage (green wire)

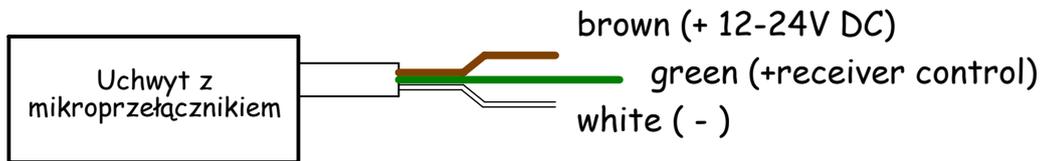

## CONNECTION TO THE DOOR BELL

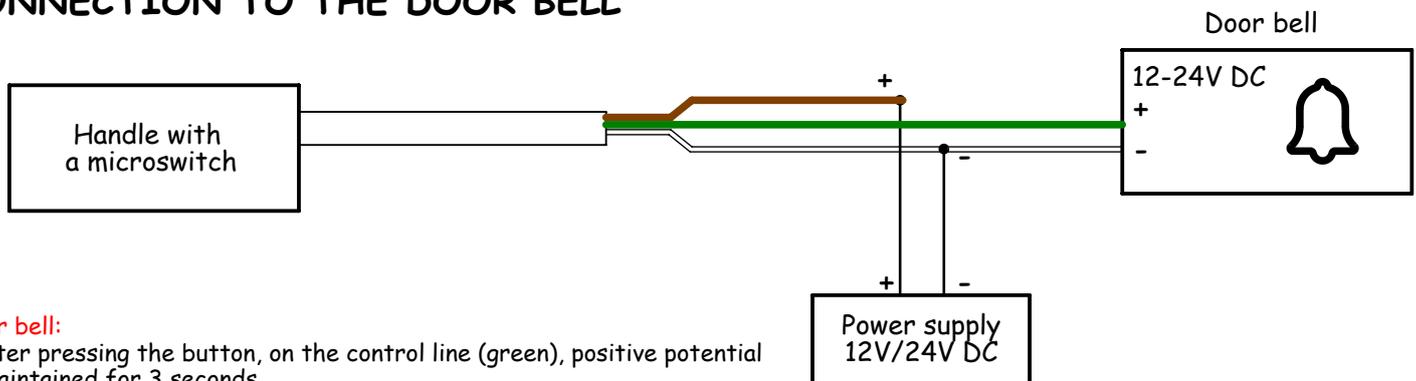

### Door bell:

- after pressing the button, on the control line (green), positive potential is maintained for 3 seconds

## INSTALLATION INSTRUCTIONS

The wires between the handle and the door should be joined using special clamping sleeves (clamp with pliers), using self-soldering sleeves or soldered.



### !!! ATTENTION !!!

- Connections can be made only by a qualified electrician, acc. to IEC 364, EN 60204-1 and VDE guidelines.
- The handle must be provided with a permanent connection to the electrical supply.
- The electrical supply lines should be connected between the building and the door using cable glands or WXelektro hinges.
- The power supply should be placed outside the joinery (surface-mounted / concealed box). It is best to solder and insulate the wires heat shrink band.